


Annex 1 to TOR\_CS-01, p. 1/2

- (1) Potential future sites for the CHP-Plant
- (2) Natural gas pipe line with possible measuring and regulation station
- (3) 110 kV switchyard
- (4) Installed new district heating piping, see p. 2/2
- (5) District heating interface to the existing TPP Bitola
- (6) Future water treatment plant for the district heating
- (7) Space reserved for a battery storage
- (8) Possible construction and laydown areas
- (9) Reservation for photo voltaic power plant
- (10) Transformer for photo voltaic plant

МРИ

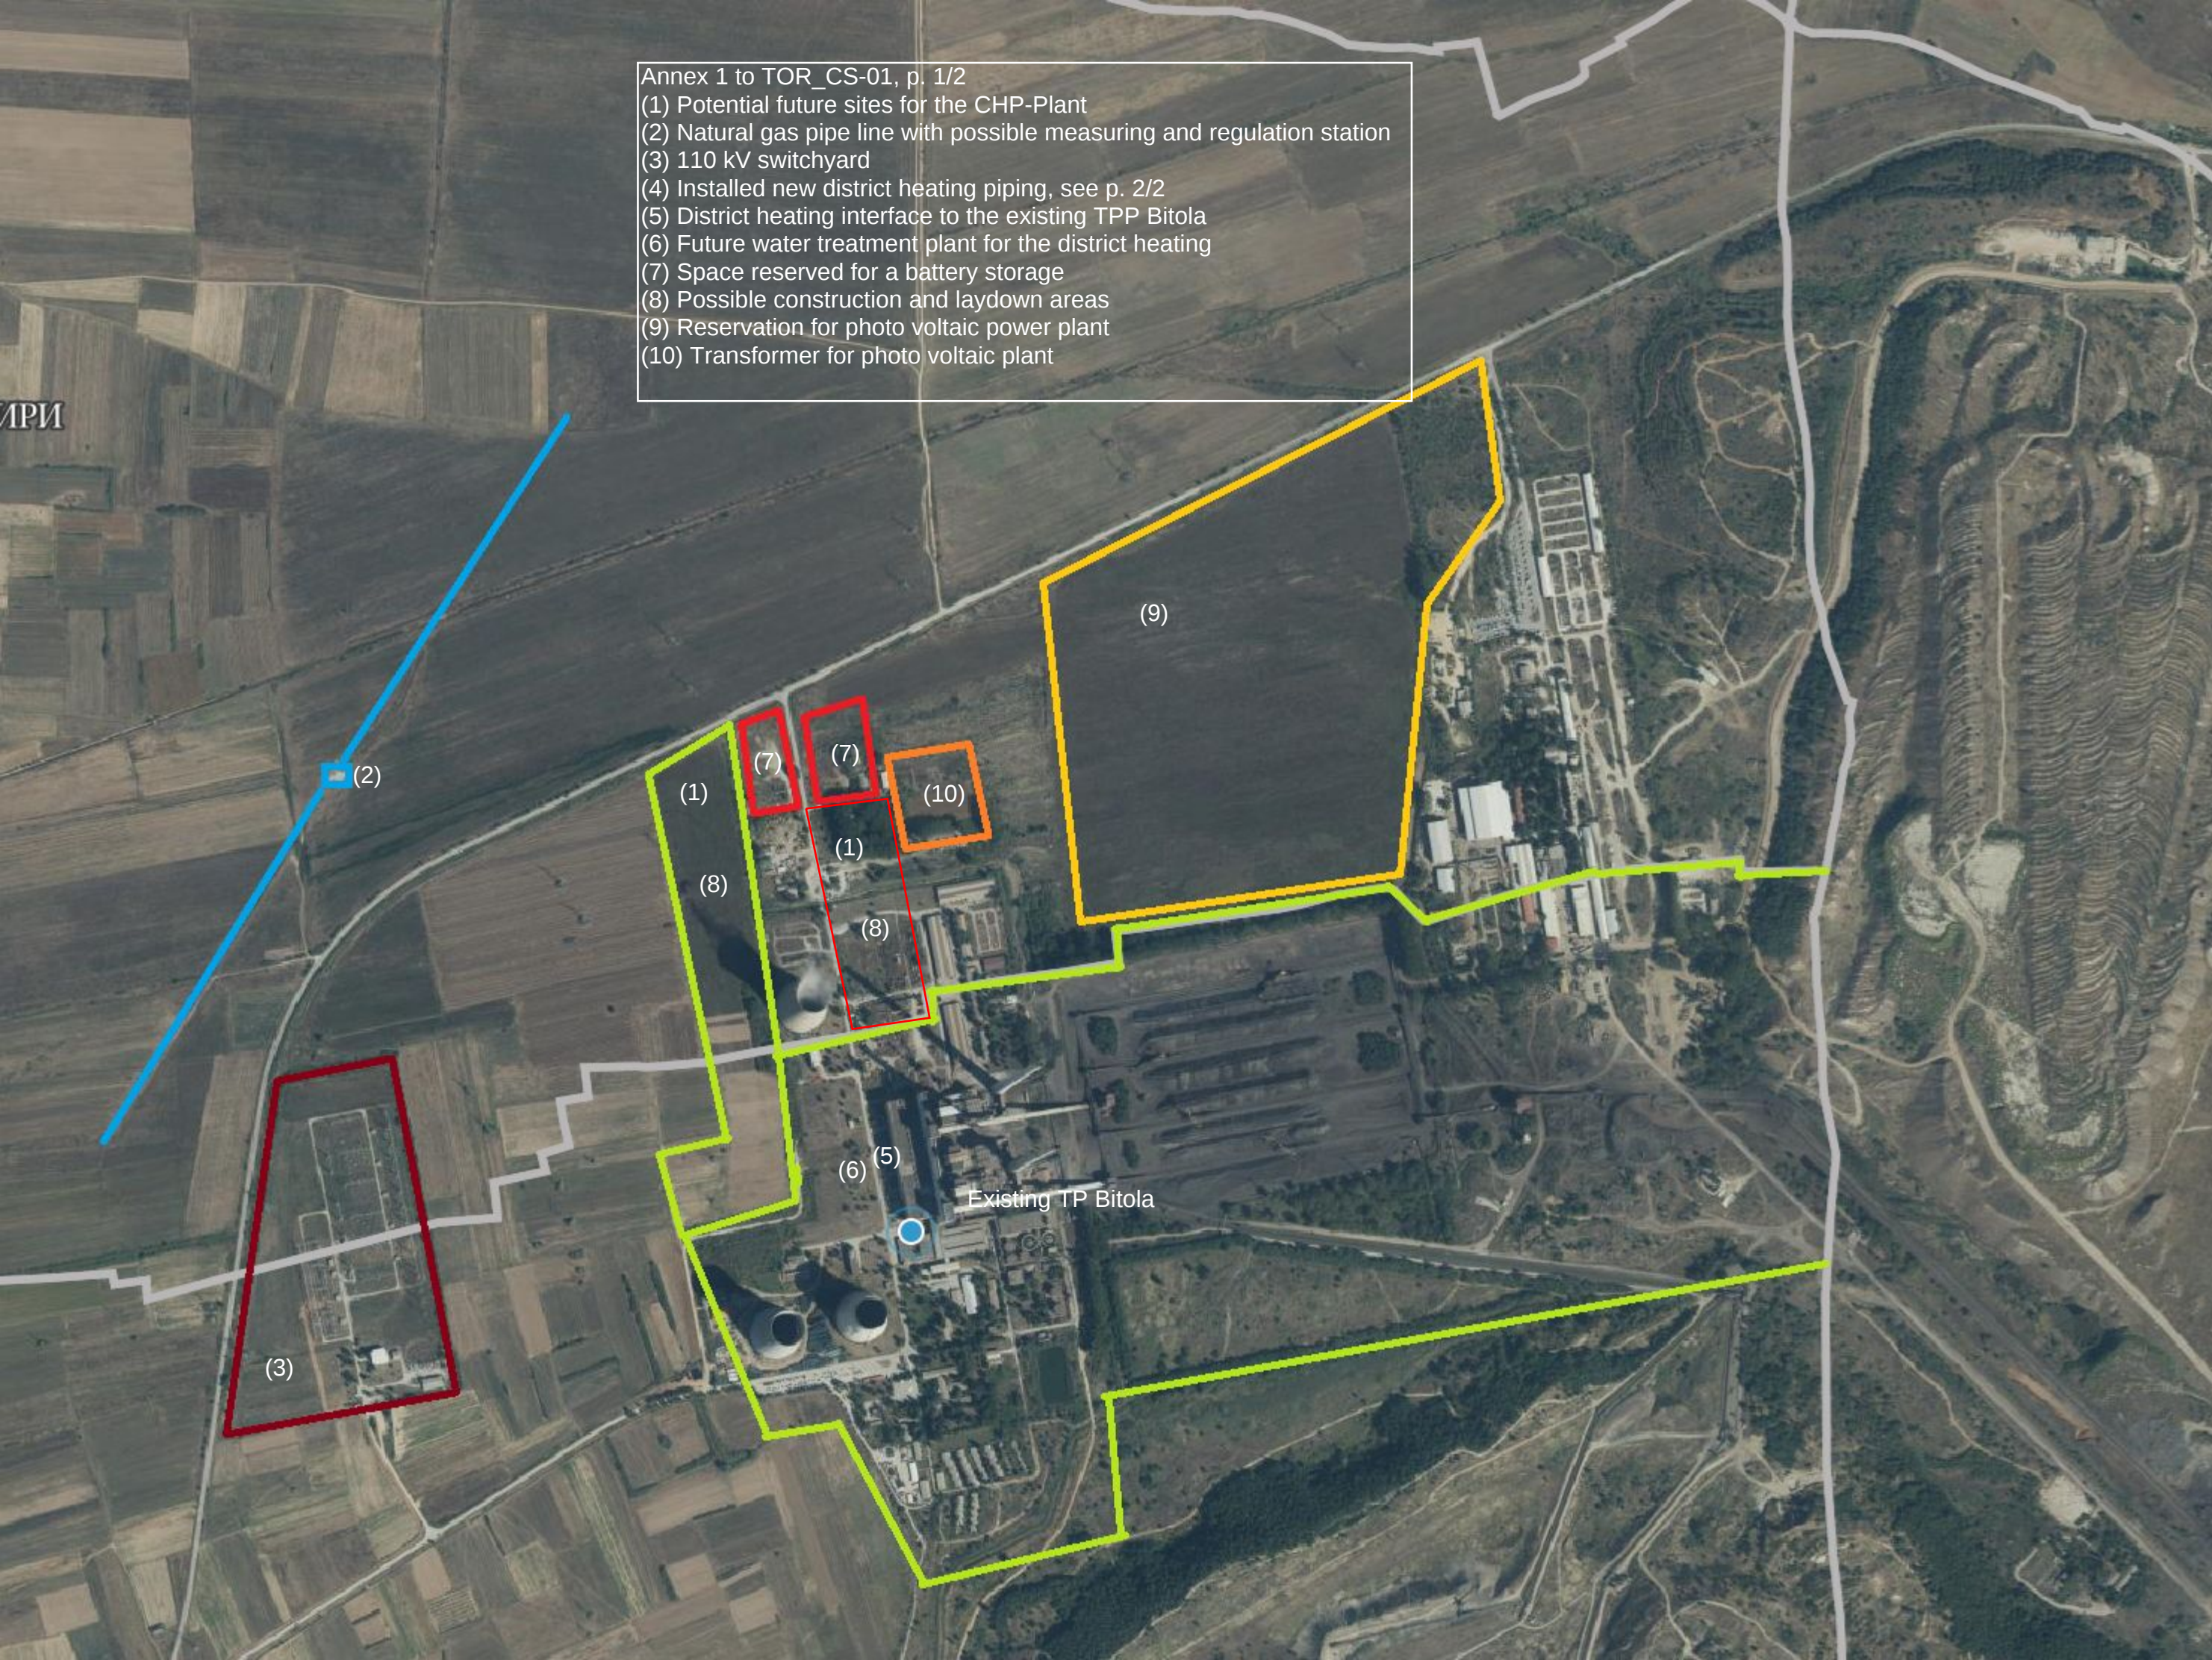

Annex 1 to TOR\_CS-01, p. 2/2:

(4) Installed new district heating piping

(5) District heating interface to the existing TPP Bitola

